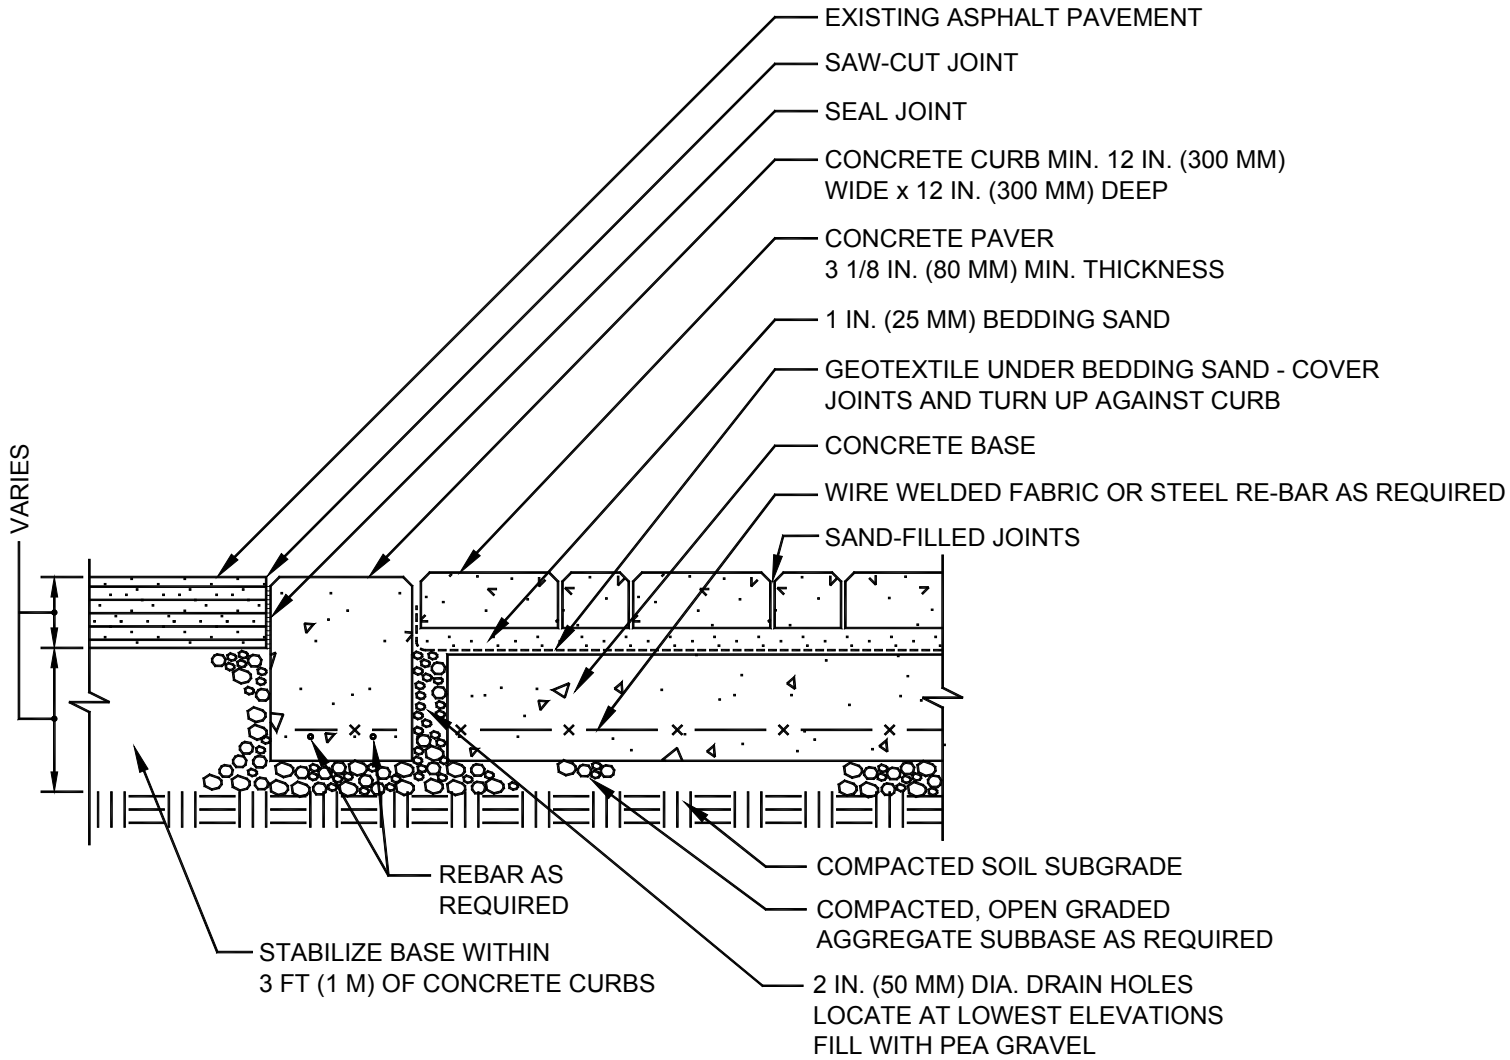

NOTE:
1. BASE THICKNESS AND REINFORCING VARIES WITH TRAFFIC, CLIMATE AND SUBGRADE CONDITIONS.
2. CONCRETE BASE MINIMUM 2% SLOPE FROM CENTERLINE TO CURB.
3. DO NOT PROVIDE DRAIN HOLES TO SUBGRADE WHEN WATER TABLE IS LESS THAN 2 FT (0.6 M) FROM TOP OF SOIL SUBGRADE. PROVIDE DRAIN HOLES TO CATCH BASINS.

CROSSWALK ON CONCRETE BASE WITH SAND SETTING BED

DRAWING NO. ICPI-12

SCALE NO SCALE